


MAXIMUM NO. OF PERSONS SERVED	LIQUID CAPACITY OF TANK		INTERNAL DIMENSIONS			
	GALLONS (APPROX.)	CUBIC FT.	LENGTH (L) FT. IN.	WIDTH (W) FT. IN.	LIQUID DEPTH (LD) FT. IN.	TOTAL DEPTH (H) FT. IN.
4	500	67	6 0	3 0	4 0	5 2
6	600	81	7 0	3 0	4 0	5 2
8	750	101	7 0	3 6	4 0	5 2
10	900	121	7 6	3 6	4 6	5 8
12	1100	148	8 6	4 0	4 6	5 8
14	1300	174	10 0	4 0	4 6	5 8
16	1500	201	10 0	4 6	4 6	5 8

SEPTIC TANK SIZING CHART
FOR RESIDENTIAL AND OTHER LOW IMPACT BUILDINGS ONLY

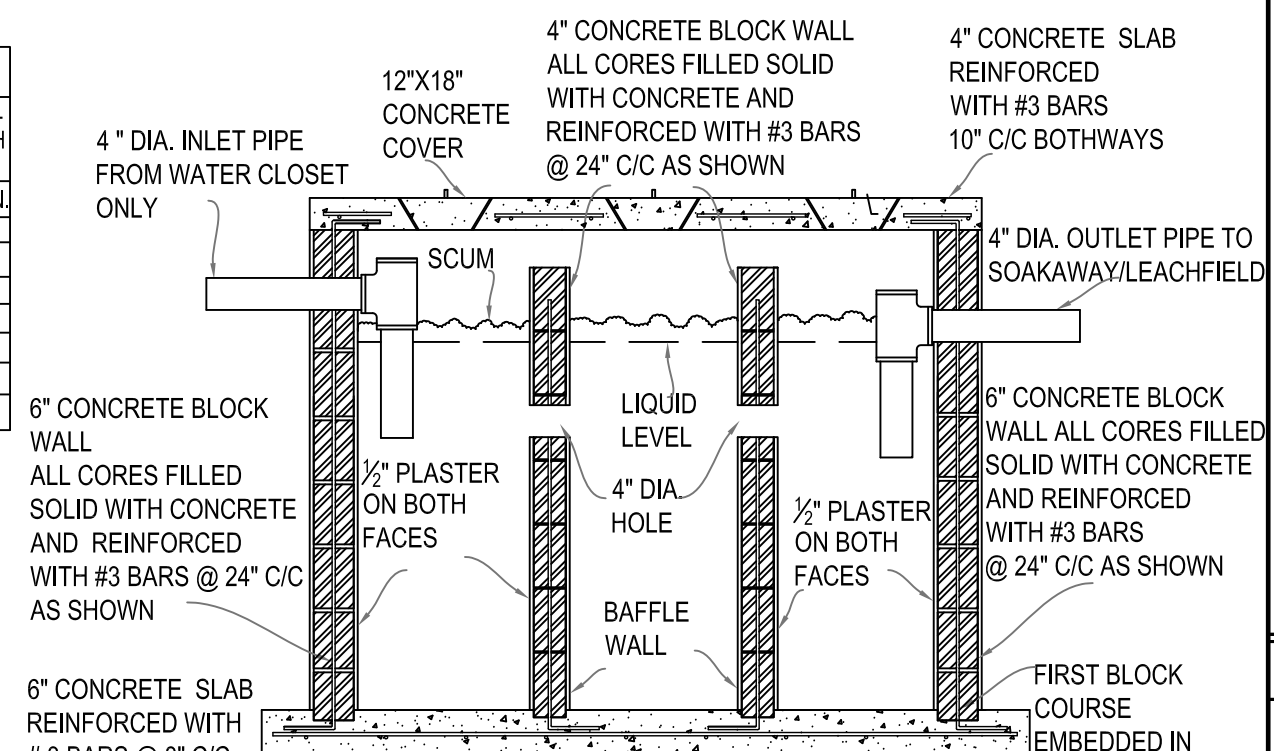

SECTION THRU SOAKAWAY
SCALE: 3/8" = 1' 0"

SOAKAWAY DETAILS
FOR RESIDENTIAL AND OTHER LOW IMPACT BUILDINGS ONLY

SEPTIC TANK DETAILS
FOR RESIDENTIAL AND OTHER LOW IMPACT BUILDINGS ONLY

- SPECIFICATIONS**
1. Inlet pipe must dip 12" below liquid level in tank.
 2. Tank must be air and water tight.
 3. Invert level of outlet pipe must be 2" minimum below top of baffle wall.



PROJECT TITLE:
TYPICAL RESIDENTIAL SEWAGE DISPOSAL SYSTEM
SHEET TITLE:
SEPTIC TANK AND SOAKAWAY DETAILS
CLIENT ADDRESS:
C.B.A.

REVIEWED BY:	P.E.S.
CLIENT NAME:	MIN. OF HEALTH
DRAWN BY:	M.E.G.
DATE:	APRIL 2010
SCALE:	AS SHOWN
SHEET No.:	1
TOTAL No. OF SHEETS	1